

Snagit Adhesive



Snagit Adhesive

Technical Data Sheet

Snagit Adhesive is a premium wood flooring adhesive for permanent bonding of timber flooring systems to most common subfloor types. Snagit Adhesive is an easy trowel formula and non-slumping, providing a consistent void fill between the subfloor and the flooring system. This formula is solvent and isocyanate free, meeting all the requirements of Greenstar and low VOC adhesives. Suitable for bonding most timber flooring systems including solid timber, plank strips, parquet, wood blocks, engineered timber, acrylic-impregnated timber and plywood. Approved for bonding to concrete, timber, plywood, cement screeds, cement sheet, moisture barriers, radiant heating, and Hebel subfloors. Also suitable for installation over steel and aluminium subfloors – it is recommended to solvent-clean steel subfloors before application of the adhesive.

Suitable Applications

Snagit Adhesive wood flooring adhesive is suitable for bonding most timber flooring systems to concrete, plywood, cured leveling compound, epoxy membranes, particle board and radiant heated subfloors.

Technical Specifications

Adhesive Polymer	Single Part Hybrid Polymer
Tensile Strength	1.6 N/mm ²
Shore A Hardness	40 ±
Elongation at Break	180%
VOC Content	< 10g / liter
Tack Free Time	20-40 minutes
Working Time	30 minutes (20°C at 50% R.H.)
Shelf Life	12 months (unopened)
Storage	Store in a dry place between 5°C and 30°C

Subfloor Preparation

- Ensure the subfloor surface is structurally sound, flat, smooth, clean, with no indentations and anti-adherents.
- Subfloor must be free of dust, dirt, grease, wax, loose paint, oil, sealers of any type, curing compounds, bond breakers, asphaltic residue, liquid adhesive remover, strippers, chemicals, or any other foreign substances that can potentially affect bonding. Cleaning the subfloor of loose particles with an industrial vacuum cleaner is recommended.
- If direct applying the adhesive to the subfloor, it must be flat to maximum 3mm over 2 meters, otherwise it will increase the risk of hollow spots and poor adhesion under the timber flooring.



- Any existing coating or adhesives must be completely removed. Mechanical treatment (e.g. shot blasting, grinding or sanding) may be required to achieve subfloor conditions mentioned above.
- It is recommended to assess slab moisture. If the slab is more than 15% moisture content measured with a concrete impedance moisture meter or more than 80% in-slab relative humidity, then additional means of protecting the floor from slab moisture is needed. Please discuss technical requirements with a Snagit Adhesive consultant for any floors with high moisture or relative humidity readings
- For use over particleboard, all surfaces should be rough sanded, including sanding flat all joints. Ensure the surface is clean, dry, sound and does not squeak prior to laying the timber flooring.
- For use over clean plywood all joints should be sanded flat. Ensure the surface is clean, dry, sound and does not squeak prior to laying the timber flooring.
- Radiant heated subfloors should be turned off 24 hours prior to and during installation to prevent premature curing of the adhesive.
- Recommended air temperature during floor installation – between 10°C - 35°C and relative humidity between 40% and 80%, subject to the requirements specified in the flooring installation requirements.

Estimated Coverage Rates

3mm V Notch Trowel	16-18m ² per pail
4mm V Notch Trowel	12-14m ² per pail
5mm V Notch Trowel	10-12m ² per pail
6mm V Notch Trowel	8-10m ² per pail

Adhesive Application:

- Remove the lid and remove the foil liner. Once open, the entire contents of the pail should be used within a short period of time.
- Spread the adhesive with the proper notched trowel, apply uniformly on the subfloor. Avoid adhesive pools and excessive adhesive.
- Floor installation is by a full adhesive bed and to the flooring manufacturer's instructions.
- Place the timber on the adhesive within the 30-minute working time, correctly position and press down firmly or tap with a rubber hammer to ensure good overall contact.
- Ensure 100% adhesive contact to the board is achieved for proper bonding to the floor and for full moisture vapour protection.
- Place heavy objects to hold the flooring firmly in place during the curing time.
- When installing near a solid object or wall, leave the necessary room for expansion as outlined in the timber system guide. Installing wood too tight against a stationary object will not allow room for normal wood expansion, which may cause a failure.
- If wedges or weights have been used during the installation to hold wood in place while adhesive dries, remove wedges after initial setting of the adhesive (approximately 2 hours) to allow for normal expansion of wood. Failure to remove wedges can cause the wood flooring to buckle and pop off the subfloor.
- Restrict foot traffic for 12 hours. Wait 24 hours before sanding.
- Uncured adhesive can be removed from prefinished flooring with a damp rag or cleaning wipes. Do not use unapproved cleaning agents on prefinished timber surfaces.
- Clean tools and equipment immediately after use with a suitable solvent such as white spirits or mineral turpentine. Cured adhesive will need to be mechanically removed.

Trowel Recommendations

- For adhesive-only performance, a 4mm or 5mm V notch trowel is suitable for most flooring systems on both concrete-to-timber and timber-to-timber applications. Using a 3mm V Notch may be required for finger block parquetry.
- *Moisture Barrier*: for concrete to timber applications where moisture barrier properties are required, a 5mm V-notched trowel should be used. Adhesive consumption with a 5mm consistent V notch trowel is approximately 11m² per pail. Important: when trowelling, 100% adhesive subfloor coverage is required to ensure moisture protection.

Product Limitations

- Do not use on wet, dusty, contaminated, or friable substrates.
- Do not dilute the adhesive.
- Resistant only to the following: water, dilute acids, diluted caustic solutions, temporarily resistant to fuel, animal fats and oils, not resistant to organic acids, concentrated caustic solutions.
- Will not prevent damage to wood flooring induced by excessive moisture transmission due to environmental factors like water leaks.

Health & Safety

Health and Safety: Keep out of reach of children. Contains aminosilane. May produce an allergic reaction. Safety data sheet available on request. Users must first read the Safety Data Sheet. Users should familiarize themselves with all the safety aspects of the product prior to usage.

Product Disclaimer:

Since the use and application of this product is beyond our control, Snagit Adhesive cannot be held responsible for product field performance if all application recommendations are not adhered to. The information presented above is the result of our considerable experience with this product but is not to be construed as a performance warranty. In any cases of possible concern it is recommended that the customer conducts their own testing and accordingly determine, to their satisfaction, its suitability for their purpose under the operating conditions in which they will use the product/s.

For additional information, phone customer support on 03 7511 5488

July 2023 - This Data Sheet supersedes those previously issued

Manufactured under licence for Oak N Craft Pty Ltd.

Snagit Adhesive

Snagit Adhesive



Emission Test Certificate

Thursday 24th July 2025

Supplier: Oak n Craft Pty Ltd

Product name: Snagit Adhesive

Date Tested: July 2025 (Tested by FORAY Laboratories – NATA Accreditation 1231)

Test Method: ASTM D5116-2025 “Standard Guide for Small-Scale Environmental Chamber Determinations of Organic Emissions from Indoor Material/Products”.

Emission Data (24 hours):

ENF Grade	Snagit Adhesive
Formaldehyde Emission Concentration Limit*: <0.025 mg/m ³	Formaldehyde Emission Concentration*: <0.004 mg/m ³

* The stated result was calculated from an emission rate applied to GreenGuard standard room model using a 13 m² exposed flooring area, a room volume of 32 m³, and a ventilation rate of 0.72 hr⁻¹.



Dr. Vyt Garnys
PhD, BSc (Hons) AIMM, ARACI, ISIAQ
ACA, AIRAH, FMA
Managing Director and Principal Consultant



Travis Hale
BSc (Biotechnology)
Senior Consultant



Dr Tuan Duong
PhD, B.Eng. (Chemical)
Senior Consultant

Snagit Adhesive

Sound Insulation Test Summary

Project Snagit Adhesive
Client Oak N Craft Pty Ltd.
Document Number AC445MB-01E07 Sound Insulation Testing Summary (r0)

Revision	Date	Comment	Author	Reviewer
0	5.04.2024	Issued to Client	HG	AL

Disclaimer

The information contained within this document has been prepared by Octave Acoustics Pty Ltd under briefing instructions, caveats and terms and conditions accepted by both the Client and Octave Acoustics Pty Ltd. The information contained within this document should not be relied upon by any third parties or applied under any context other than that described within this document.

The information within this report shall remain the property of Octave Acoustics Pty Ltd. Octave Acoustics Pty Ltd shall retain all common law, statutory and other reserved rights, including copyright thereto. As such the information contained within this report should not be distributed to third parties without the written consent of Octave Acoustics Pty Ltd.



1. Summary of Sound Insulation Testing

Octave Acoustics was engaged by Woodcut to carry out impact sound insulation testing on two flooring samples bonded with Snagit Adhesive.

Octave Acoustics conducted two impact sound insulation tests (one on a timber floor sample and one on a vinyl floor sample) on Thursday the 30th of November 2023. Testing was conducted at a multi-residential building that was under construction at 334 City Road, Southbank.

Floor impact sound insulation testing was conducted in general accordance with AS/ISO 140-7 measurement procedures and results assessed and presented in accordance with AS/ISO 717-2 calculation procedures.

All floor impact test results satisfy the applicable NCC/BCA requirement of $L'_{nTW} \leq 62$.

Detailed results of each sound insulation test are located in the following appendices:

- Appendix A contains the impact sound insulation test report for a vinyl sample bonded with 'Snagit Adhesive' with a 6mm V Notch.
- Appendix B contains the impact sound insulation test report for an engineered timber sample bonded with 'Snagit Adhesive' with a 6mm V Notch.
- Appendix C contains the impact sound insulation test report for the 220mm thick bare concrete slab with suspended ceiling.
- Appendix D contains the impact sound insulation test methodology.



1.1. Impact Sound Insulation Results

The results of the impact sound insulation testing are summarised in Table 1 below.

Table 1 – Floor Impact Sound Insulation Field Test Summary

Bonding Material	Sample Material	V Notch Depth	Field Test Result L'_{nTw}	NCC/BCA Requirement L'_{nTw}	Complies with NCC/BCA Requirement
Snagit Adhesive	Vinyl	6mm	48	≤ 62	Yes
Snagit Adhesive	Engineered Timber	6mm	48	≤ 62	Yes
N/A	Bare Concrete Slab	N/A	61	≤ 62	Yes



Appendix A: Impact Sound Insulation Field Test Report for a Vinyl Sample Bonded With 'Snagit Adhesive' with a 6mm V Notch

Impact Sound Insulation Field Test Summary		
Date of test	30 th November 2023	
Form of construction	1220mm x 900mm sample patch of 5.5mm vinyl bonded with 'Snagit Adhesive' with a 6mm V Notch on top of a 220mm thick concrete slab with a 13mm thick suspended plasterboard ceiling underneath separated by a cavity depth of 80mm.	
Measured Weighted Standardised Impact Sound Pressure Level	L'_{nTw}	48
Minimum requirement of the Building Code of Australia	L'_{nTw}	≤ 62
Complies with NCC/BCA requirement?	Yes	



Standardized Impact Sound Pressure Level according to ISO 140-7

Field measurements of impact sound insulation of floors

Client: Oak N Craft Pty Ltd


Date of test: 30/11/2023

Description and identification of the building construction and test arrangement:

1220mm x 900mm x 5.5mm Vinyl bonded with 'Snagit Adhesive' with a 6mm V Notch on top of a 220mm thick concrete slab with a 13mm thick suspended plaster ceiling underneath separated by a cavity depth of 80mm.

Frequency f Hz	L'nT 1/3 Octave dB
50	51.2 B
63	54.3
80	50.9
100	57.8
125	55.3
160	58.8
200	57.1
250	47.6
315	44.7
400	41.5
500	37.3 B
630	34.4 B
800	34.0 B
1000	33.5 B
1250	32.2 B
1600	30.6 B
2000	27.8 B
2500	24.2 B
3150	20.2 B
4000	17.9 B
5000	15.3 B

B: L'nT =< value shown

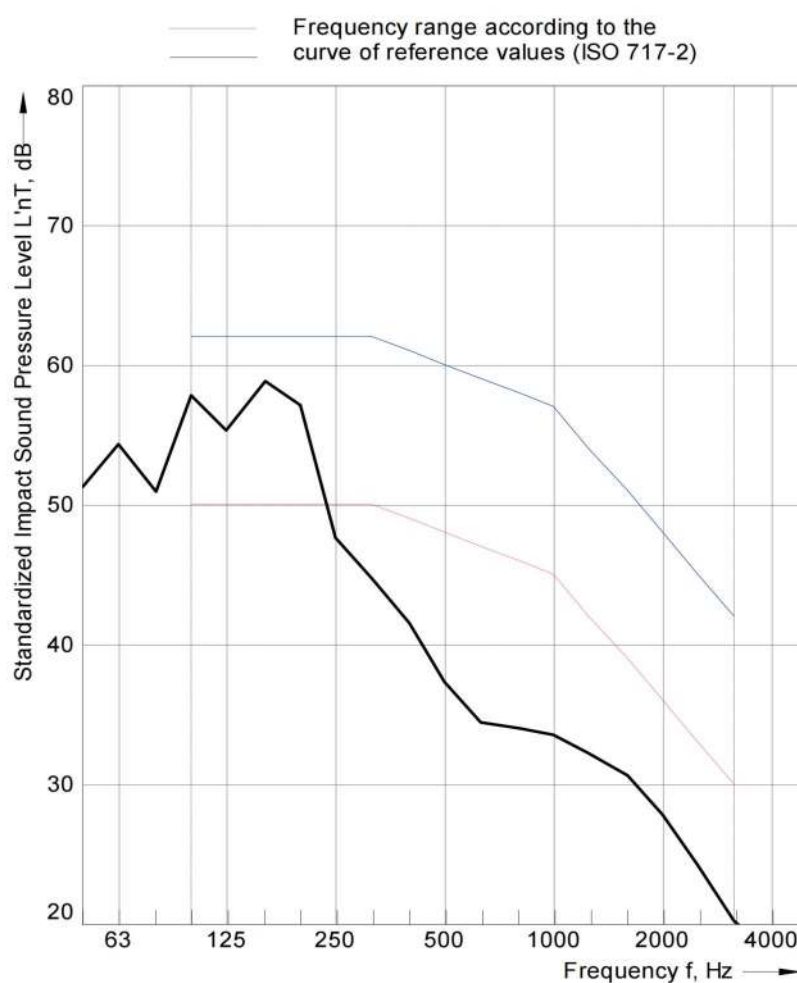

Rating according to ISO 717-2

$$L'_{nT,w}(C_i) = 48 (1) \text{ dB}$$

$$C_{i,50-2500} = 2 \text{ dB}$$

Evaluation based on field measurement results obtained in one-third-octave bands by an engineering method

No. of test report: AC455MB-01E07

Name of test institute: Octave Acoustics

Date: 05/04/2024

Signature: Harrison Green

Appendix B: Impact Sound Insulation Field Test Report for an Engineered Timber Sample Bonded With 'Snagit Adhesive' with a 6mm V Notch

Impact Sound Insulation Field Test Summary		
Date of test	30 th November 2023	
Form of construction	950mm x 770mm sample patch of 14mm engineered timber bonded with 'Snagit Adhesive' with a 6mm V Notch on top of a 220mm thick concrete slab with a 13mm thick suspended plasterboard ceiling underneath separated by a cavity of 80mm.	
Measured Weighted Standardised Impact Sound Pressure Level	L'_{nTw}	48
Minimum requirement of the Building Code of Australia	L'_{nTw}	≤ 62
Complies with NCC/BCA requirement?	Yes	



Standardized Impact Sound Pressure Level according to ISO 140-7

Field measurements of impact sound insulation of floors

Client: Oak N Craft Pty Ltd.


Date of test: 30/11/2023

Description and identification of the building construction and test arrangement:

950mm x 770mm x 14mm Engineered timber bonded with 'Snagit Adhesive' with a 6mm VNotch on top of a 220mm thick concrete slab with a 13mm thick suspended plaster ceiling underneath separated by a cavity depth of 80mm.

Frequency f Hz	L'nT 1/3 Octave dB
50	53.3 B
63	57.1
80	55.4
100	54.7
125	53.4
160	57.1
200	55.9
250	48.5
315	47.1
400	46.8
500	46.6
630	46.3
800	46.8
1000	46.1
1250	44.5
1600	43.4
2000	42.0
2500	40.7
3150	31.4
4000	20.9 B
5000	19.4

B: L'nT =< value shown

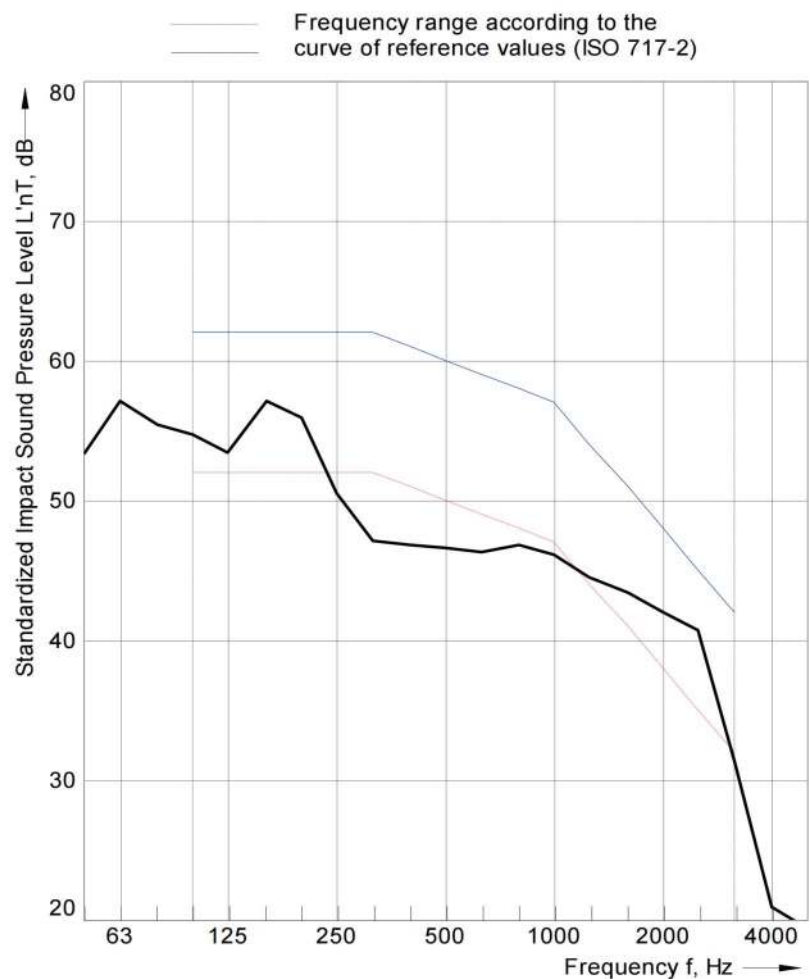

Rating according to ISO 717-2

$L'_{nT,w}(C_i) = 48 (-2) \text{ dB}$

$C_{i,50-2500} = 0 \text{ dB}$

Evaluation based on field measurement results obtained in one-third-octave bands by an engineering method

No. of test report: AC455MB-01E07

Name of test institute: Octave Acoustics

Date: 05/04/2024

Signature: Harrison Green

Appendix C: Impact Sound Insulation Field Test Report for 220mm Thick Concrete Slab

Impact Sound Insulation Field Test Summary		
Date of test	30 th November 2023	
Form of construction	Bare 220mm thick concrete slab with a 13mm thick suspended plasterboard ceiling underneath separated by a cavity of 80mm.	
Measured Weighted Standardised Impact Sound Pressure Level	L'_{nTw}	61
Minimum requirement of the Building Code of Australia	L'_{nTw}	≤ 62
Complies with NCC/BCA requirement?	Yes	



Standardized Impact Sound Pressure Level according to ISO 140-7


Field measurements of impact sound insulation of floors

Client: Oak N Craft Pty Ltd.

Date of test: 30/11/2023

Description and identification of the building construction and test arrangement:

220mm thick concrete slab with a 13mm thick suspended plaster ceiling underneath separated by a cavity depth of 80mm.

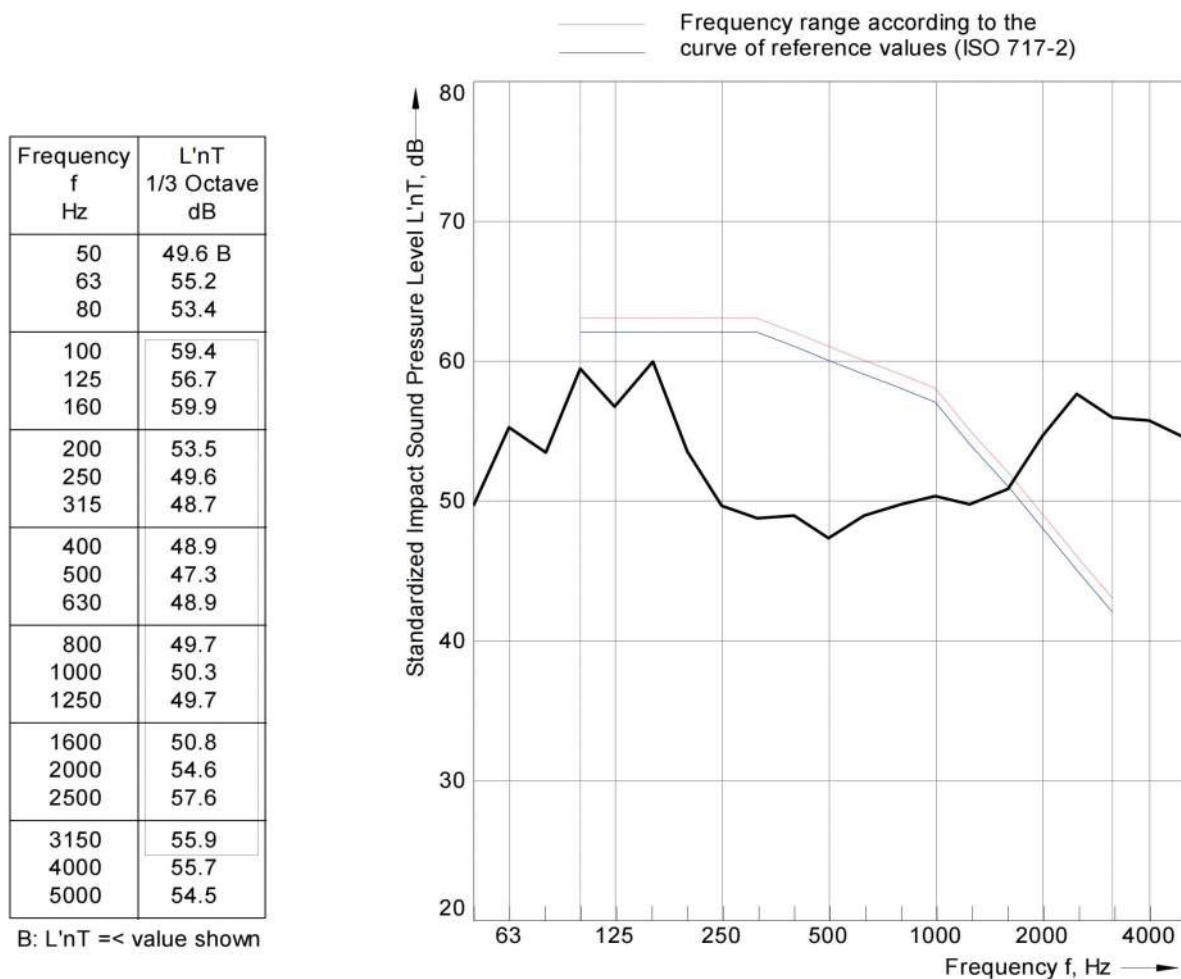

Rating according to ISO 717-2

$L'_{nT,w}(C_i) = 61 (-10) \text{ dB}$

$C_{i,50-2500} = -9 \text{ dB}$

Evaluation based on field measurement results obtained in one-third-octave bands by an engineering method

No. of test report: AC455MB-01E07

Name of test institute: Octave Acoustics

Date: 05/04/2024

Signature: Harrison Green

Appendix D: Impact Sound Insulation Test Methodology

Instrumentation

The following instrumentation was utilised for the purposes of conducting the testing:

- Bruel Kjaer 2270 sound level meter
- Norsonic Nor277 tapping machine
- Bruel Kjaer 4231 calibrator

The sound level meter was calibrated before and after all measurements. No drift in calibration was detected. The Bruel Kjaer 2270 sound level meter complies with the requirements of IEC 61672-1:2013 Sound Level Meters and is classified as a Class 1 instrument. The calibrator complies with the requirements of IEC 60942:2004 Sound Calibrators. Both the Bruel Kjaer 2270 and calibrator carry current NATA certification. The Norsonic Nor277 tapping machine conforms with the requirements of ISO140-7 Annex A.

Applicable Standards

Measurements were conducted based on the requirements of:

- AS/ISO 140-7 *Acoustics – Measurement of sound insulation in buildings and of building elements – Part 7: Field measurements of impact sound insulation of floors.*
- AS/ISO 717-2 *Acoustics – Measurement of sound insulation in buildings and of building elements – Part 2: Impact sound insulation.*
- AS/ISO 354 *Acoustics – Measurement of sound absorption in a reverberation room.*

Measurement Procedure

- Two tapping machine locations on timber, vinyl and concrete floor surfaces were selected in general accordance with AS/ISO 140-7.
- With the tapping machine running, the resulting sound pressure level was measured in the receiving room at each of four microphone locations. Each measurement was carried out in one third octave bands with an averaging time of 10 seconds.
- Ambient background noise levels without the tapping machine running were measured in the receiver room immediately before each tapping test.
- The reverberation time within the receiver room was measured in general accordance with AS/ISO 354. This involved measurements in one third octave bands using the integrated impulse response method.

Safety Data Sheet

Rev 2 – July 2023

Snagit Adhesive

Section 1 – Identification of the Material and Supplier

Snagit Adhesives

2 Anzed Court,
Mulgrave VIC 3170

P: 03 7511 5488

E: hello@oakndesign.co

W: www.oakndesign.co

Chemical Nature:	Single Component Hybrid Polymer Adhesive
Trade Name:	Snagit Adhesive
Product Use:	Flooring Adhesive
Creation Date:	October 2022
This version issued:	October 2022 and is valid for 5 years from this date
Poisons Information Centre:	Call 0800 764 766 from anywhere in New Zealand

Section 2 – Hazards Identification

Statement of Hazardous Nature

This product is not classified as hazardous according to the SWA criteria

This product is not a dangerous good according to Australian Dangerous Goods (ADG) Code, IATA or IMDG/IMSBC criteria

SUSMP Classification: None allocated.

ADG Classification: None allocated. Not a Dangerous Good according to the Australian Dangerous Good (ADG) Code, IATA or IMDG/IMSBC criteria.

UN Number: None allocated.

GHS Signal Word: None - not hazardous.

Prevention

P262: Do not get in eyes, on skin, or on clothing

P264: Wash contacted areas thoroughly after handling

P281: Use personal protective equipment as required

Response

P362: Take off contaminated clothing and wash before reuse

P301+PP330+P331: IF SWALLOWED: rinse mouth. Do NOT induce vomiting.

P370+P378: In case of fire, use carbon dioxide, dry chemical, foam, water fog

Storage

P501: If they cannot be recycled, dispose of contents to an approved waste disposal plant and containers to landfill (see Section 13 of this S



EMERGENCY INFORMATION

Physical Description & Colour: Pink

Odour: Low Odour

Major Health Hazards: No significant risk factors have been found for this product.

Section 3 – Composition & Information on Ingredients

Ingredients: Silane Modified Polymers, Calcium Carbonate, Refined Mineral (100%)

TWA (mg/m³): not set

STEL (mg/m³): not set

This is a commercial product whose exact ratio of components may vary slightly. Minor quantities of other nonhazardous ingredients are also possible.

The SWA TWA exposure value is the average airborne concentration of a particular substance when calculated over a normal 8 hour working day for a 5-day working week. The STEL (Short Term Exposure Limit) is an exposure value that may be equalled (but should not be exceeded) for no longer than 15 minutes and should not be repeated more than 4 times per day. There should be at least 60 minutes between successive exposures at the STEL. The term "peak "is used when the TWA limit, because of the rapid action of the substance, should never be exceeded, even briefly.

Section 4 – First Aid Measures

General Information: You should call The Poisons Information Centre if you feel that you may have been poisoned, burned or irritated by this product. The number is 13 1126 from anywhere in Australia (0800 764 766 in New Zealand) and is available at all times. Have this SDS with you when you call.

Inhalation: No first aid measures normally required. However, if inhalation has occurred, and irritation has developed, remove to fresh air and observe until recovered. If irritation becomes painful or persists more than about 30 minutes, seek medical advice.

Skin Contact: Gently brush away excess particles. Irritation is unlikely. However, if irritation does occur, flush with lukewarm, gently flowing water for 5 minutes or until chemical is removed.

Eye Contact: Quickly and gently brush particles from eyes. No effects expected. If irritation does occur, flush contaminated eye(s) with lukewarm, gently flowing water for 5 minutes or until the product is removed. Obtain medical advice if irritation becomes painful or lasts more than a few minutes. Take special care if exposed person is wearing contact lenses.

Ingestion: If nausea or gastric upset develops, remove individual to rest area and monitor. If symptoms get worse or if individual becomes distressed, do NOT induce vomiting; contact the Poisons Information Centre or a doctor.



Section 5 – Fire Fighting Measures

Fire and Explosion Hazards: The major hazard in fires is usually inhalation of heated and toxic or oxygen deficient (or both), fire gases. There is no risk of an explosion from this product under normal circumstances if it is involved in a fire.

Fire decomposition products from this product may be toxic if inhaled. Take appropriate protective measures.

Extinguishing Media: In case of fire, use carbon dioxide, dry chemical, foam or water fog. Avoid the use of high pressure water jet.

Fire Fighting: If a significant quantity of this product is involved in a fire, call the fire brigade.

Flash point: >200°C

Upper Flammability Limit: No data.

Lower Flammability Limit: No data.

Autoignition temperature: No data.

Flammability Class: No data.

Section 6 – Accidental Release Measures

Accidental release: Minor spills do not normally need any special clean-up measures.

In the event of a major spill, prevent spillage from entering drains or water courses.

As a minimum, wear overalls, goggles and gloves. Suitable materials for protective clothing include no specific manufacturer recommendations. Use impermeable gloves with care. Eye/face protective equipment should comprise, as a minimum, protective glasses and, preferably, goggles. If there is a significant chance that dusts are likely to build up in clean-up area, we recommend that you use a suitable dust mask.

Stop leak if safe to do so and contain spill. Sweep up and shovel or collect recoverable product into labelled containers for recycling or salvage and dispose of promptly. Consider vacuuming if appropriate.

Recycle containers wherever possible after careful cleaning. After spills, wash area preventing runoff from entering drains. If a significant quantity of material enters drains, advise emergency services.

This material may be suitable for approved landfill. Ensure legality of disposal by consulting regulations prior to disposal.

Thoroughly launder protective clothing before storage or re-use. Advise laundry of nature of contamination when sending contaminated clothing to laundry.

Section 7 – Handling and Storage

Handling: Keep exposure to this product to a minimum, and minimise the quantities kept in work areas. Check Section 8 of this SDS for details of personal protective measures, and make sure that those measures are followed. The measures detailed below under "Storage" should be followed during handling in order to minimise risks to persons using the product in the workplace. Also, avoid contact or contamination of product with incompatible materials listed in Section 10.

Storage: Store packages of this product in a cool place. Keep containers dry and away from water. Keep away from heat and flame. Keep away from sources of ignition such as sparks and open flames. Make sure that the product does not come into contact with substances listed under "Incompatibilities" in Section 10. Check packaging - there may be further storage instructions on the label.



Section 8 – Exposure Controls and Personal Protection

The following Australian Standards will provide general advice regarding safety clothing and equipment:

Respiratory equipment: **AS/NZS 1715**,
Protective Gloves: **AS 2161**,
Occupational Protective Clothing: **AS/NZS 4501** set 2008,
Industrial Eye Protection: **AS1336** and **AS/NZS 1337**,
Occupational Protective Footwear: **AS/NZS2210**.

Exposure limits have not been established by SWA for this product.

No special equipment is usually needed when occasionally handling small quantities. The following instructions are for bulk handling or where regular exposure in an occupational setting occurs without proper containment systems.

Ventilation: This product should only be used where there is ventilation that is adequate to keep exposure below the TWA levels. If necessary, use a fan.

Eye Protection: Eye protection is not normally necessary when this product is being used. However, if in doubt, wear suitable protective glasses or goggles.

Skin Protection: The information at hand indicates that this product is not harmful and that normally no special skin protection is necessary. However, we suggest that you routinely avoid contact with all chemical products and that you wear suitable gloves (preferably elbow-length) when skin contact is likely.

Protective Material Types: There is no data that enables us to recommend any type except that it should be impermeable.

Respirator: If there is a significant chance that dusts are likely to build up in the area where this product is being used, we recommend that you use a suitable dust mask. Otherwise, not normally necessary.

Section 9 – Physical and Chemical Properties

Physical Description & colour:	Pink
Odour:	Low sweetish odour.
Boiling Point:	>100°C.
Freezing/Melting Point:	No specific data. Solid at normal temperatures.
Volatiles:	No data.
Vapour Pressure:	At 20°C, 23 hPa
Vapour Density:	Water.
Specific Gravity:	1.50 +/-
Volatility:	Low
Odour Threshold:	No data.
Evaporation Rate:	Not applicable.
Coeff Oil/water Distribution:	No data
Viscosity:	At 20°C > 9,000mPa.s
Autoignition temp:	Non Flammable



Section 10 – Stability and Reactivity

Reactivity: This product is unlikely to react or decompose under normal storage conditions. However, if you have any doubts, contact the supplier for advice on shelf life properties.

Conditions to Avoid: This product should be kept in a cool place, preferably below 30°C. Containers should be kept dry. Keep away from heat, flames and sparks. Keep away from sources of sparks or ignition.

Incompatibilities: strong oxidising agents.

Fire Decomposition: Combustion forms carbon dioxide, and if incomplete, carbon monoxide and possibly smoke. Water is also formed. Carbon monoxide poisoning produces headache, weakness, nausea, dizziness, confusion, dimness of vision, disturbance of judgment, and unconsciousness followed by coma and death.

Polymerisation: Polymerisation reactions are unlikely and not expected to occur.

Section 11 – Toxicological Information

Target Organs: There is no data to hand indicting any particular target organs.

Classification of Hazardous Ingredients: No ingredient mentioned in the HSIS Database is present in this product at hazardous concentrations.

Potential Health Effects

Inhalation:

Short Term Exposure: Available data indicates that this product is not harmful. However, product may be mildly irritating, although unlikely to cause anything more than mild transient discomfort.

Long Term Exposure: No data for health effects associated with long term inhalation.

Skin Contact:

Short Term Exposure: Available data indicates that this product is not harmful. It should present no hazards in normal use. However, product may be mildly irritating, but is unlikely to cause anything more than mild discomfort which should disappear once contact ceases.

Long Term Exposure: No data for health effects associated with long term skin exposure.

Eye Contact:

Short Term Exposure: This product may be mildly irritating to eyes but is unlikely to cause anything more than mild discomfort which should disappear once product is removed.

Long Term Exposure: No data for health effects associated with long term eye exposure.

Ingestion:

Short Term Exposure: Significant oral exposure is considered to be unlikely. This product, while believed to be not harmful, is likely to cause headache and gastric disturbance such as nausea and vomiting if ingested in significant quantities. However, this product may be mildly irritating to mucous membranes but is unlikely to cause anything more than mild transient discomfort.

Long Term Exposure: No data for health effects associated with long term ingestion.

Carcinogen Status:

SWA: No significant ingredient is classified as carcinogenic by SWA.

NTP: No significant ingredient is classified as carcinogenic by NTP.

IARC: No significant ingredient is classified as carcinogenic by IARC.



Section 12 – Ecological Information

Insufficient data to be sure of status.

Section 13 – Disposal Considerations

Disposal: This product may be recycled if unused, or if it has not been contaminated to make it unsuitable for its intended use. If it has been contaminated, it may be possible to reclaim the product by filtration, distillation or some other means. If neither of these options is suitable in-house, consider controlled incineration, or contact a specialist waste disposal company.

Section 14 – Transport Information

UN Number: This product is not classified as a Dangerous Good by ADG, IATA or IMDG/IMSBC criteria. No special transport conditions are necessary unless required by other regulations.

Section 15 – Regulatory Information

AICS: This product is compliant with NICNAS regulations.

Section 16 – Other Information

This SDS contains only safety-related information. For other data see product literature.

Acronyms:

ADG Code	<i>Australian Code for the Transport of Dangerous Goods by Road and Rail (7th edition)</i>
AICS	<i>Australian Inventory of Chemical Substances</i>
SWA	<i>Safe Work Australia, formerly ASCC and NOHSC</i>
CAS number	<i>Chemical Abstracts Service Registry Number</i>
Hazchem Code	<i>Emergency action code of numbers and letters that provide information to emergency services especially firefighters</i>
IARC	<i>International Agency for Research on Cancer</i>
NOS	<i>Not otherwise specified</i>
NTP	<i>National Toxicology Program (USA)</i>
R-Phrase	<i>Risk Phrase</i>
SUSMP	<i>Standard for the Uniform Scheduling of Medicines & Poisons</i>
UN Number	<i>United Nations Number</i>



THIS SDS SUMMARISES OUR BEST KNOWLEDGE OF THE HEALTH AND SAFETY HAZARD INFORMATION OF THE PRODUCT AND HOW TO SAFELY HANDLE AND USE THE PRODUCT IN THE WORKPLACE. EACH USER MUST REVIEW THIS SDS IN THE CONTEXT OF HOW THE PRODUCT WILL BE HANDLED AND USED IN THE WORKPLACE. IF CLARIFICATION OR FURTHER INFORMATION IS NEEDED TO ENSURE THAT AN APPROPRIATE RISK ASSESSMENT CAN BE MADE, THE USER SHOULD CONTACT THIS COMPANY, SO WE CAN ATTEMPT TO OBTAIN ADDITIONAL INFORMATION FROM OUR SUPPLIERS
OUR RESPONSIBILITY FOR PRODUCTS SOLD IS SUBJECT TO OUR STANDARD TERMS AND CONDITIONS, A COPY OF WHICH IS SENT TO OUR CUSTOMERS AND IS ALSO AVAILABLE ON REQUEST.

Please read all labels carefully before using product.

This SDS is prepared in accord with the SWA document "Preparation of Safety Data Sheets for Hazardous Chemicals - Code of Practice" (December 2011)

Copyright © Kilford & Kilford Pty Ltd, October 2022.

